

SUORITUSTASOILMOITUS

HECO-DoP_ETA_15/0784_MMS-plus_1606_FI

1. Tuotetyypin yksilöllinen tunnistus:
MULTI-MONTI-plus (MMS-plus)

2. Tyyppi-, erä- tai sarjanumero tai muu merkintä, jonka ansiosta rakennustuotteet voidaan tunnistaa, kuten 11 artiklan 4 kohdassa edellytetään:

Tunnistaminen ETA-15/0784 liite A2, A3 mukaisesti
Eränumero: ks. Tuotepakkaus

3. Valmistajan ennakoima, sovellettavan yhdenmukaistetun teknisen eritelmän mukainen rakennustuotteen aiottu käyttötarkoitus tai -tarkoitukset:
ETA-15/0784 liite B1

Vaarnatyyppi	Ruuviankkuri
Käyttökohde	<u>Betoni C20/25–C50/60 (EN 206)</u> – halkeilematon: Ø 6, Ø 7,5, Ø 10 ja Ø 12 – halkeillut: Ø 6, Ø 7,5, Ø 10 ja Ø 12
Optio/luokka	<u>Optio 1</u> Seisminen: suoritustasoluokka C1
Kuormitus	Staattinen, osittain staattinen, seisminen (Ø 10 + Ø 12), palon kesto
Materiaali/malli	<u>Sinkitty teräs:</u> – käytettäväksi kuivissa sisätiloissa – erilaisia kannan muotoja

4. Valmistajan nimi, rekisteröity kaupp nimi tai tavaramerkki sekä osoite, josta valmistajaan saa yhteyden, kuten 11 artiklan 5 kohdassa edellytetään:

HECO-Schrauben GmbH & Co. KG
Dr.-Kurt-Steim-Str. 28
78713 Schramberg (Saksa)

5. Mahdollisen valtuutetun edustajan, jonka toimeksianto on kuuluvat 12 artiklan 2 kohdassa eritellyt tehtävät, nimi sekä osoite, josta tähän saa yhteyden:
-

6. Rakennustuotteen suoritustason pysyvyyden arviointi- ja varmennusjärjestelmä(t) liitteen V mukaisesti:
Järjestelmä 1

7. Kun kyse on yhdenmukaistetun standardin piiriin kuuluvan rakennustuotteen suoritustasoilmoituksesta:
-

8. Kun kyse on suoritustasoilmoituksesta, joka koskee rakennustuotetta, josta on annettu eurooppalainen tekninen arviointi:

- Teknisen arvioinnin suorittaja: Deutsches Institut für Bautechnik (DIBt)
- Ilmoitettu taho: Otto-Graf-Institut Stuttgart, tunniste 0672
- Arviointiasiakirja: ETAG 001, osa 1, 3 (04.2013)
- Vaatimustenmukaisuustodistus: 0672-CPR-0635

9. Ilmoitetut suoritustasot

Keskeiset ominaisuudet	Mittausmenetelmä	Teho	Yhdenmukaistettu tekninen erittely
Vetolujuuden ominaisarvot	ETAG 001, liite: C, menetelmä A CEN/TS 1992-4:2009, menetelmä A	ETA-15/0784: liite C1	ETAG 001 Part 1, 3 ETAG 001, liite E EOTA TR 020 (palon kesto)
	EOTA TR 045	ETA-15/0784: liite C2	
	EOTA TR 020(palon kesto) CEN/TS 1992-4: liite D	ETA-15/0784: liite C3	
Leikkuuvoiman ominaisarvot	ETAG 001, liite: C, menetelmä A CEN/TS 1992-4:2009, menetelmä A	ETA-15/0784: liite C1	
	EOTA TR 045	ETA-15/0784: liite C2	
	EOTA TR 020 (palon kesto) CEN/TS 1992-4: liite D	ETA-15/0784: liite C3	
Asennuksen tunnusarvot		ETA-15/0784: liite B2	
Käyttökelpoisuuden rajatilan siirtymät	ETAG 001, liite: C, menetelmä A CEN/TS 1992-4:2009, menetelmä A	ETA-15/0784: liite C4	

10. Edellä 1 ja 2 kohdassa yksilöidyn tuotteen suoritustasot ovat 9 kohdassa ilmoitettujen suoritustasojen mukaiset. Tämä suoritustasoilmoitus on annettu 4 kohdassa ilmoitetun valmistajan yksinomaisella vastuulla.

Valmistajan puolesta allekirjoittanut:



Schramberg, 01.07.2016

i.V.

Andreas Hettich, Tuote- ja markkinointipäällikkö

Specifications of intended use

Use of the anchoring:

- Static and quasi static loads: all sizes.
- Seismic category C1:
MMS-plus all Versions, size 10 with maximum embedment depth (h_{nom2}) and size 12 with the embedment depth h_{nom1} and h_{nom2} .
- Fire exposure: all sizes.

Base Materials:

- Reinforced or non-reinforced normal weight concrete according to EN 206-1:2000.
- Strength classes C20/25 to C50/60 according to EN 206-1:2000.
- Non-cracked and cracked concrete: all sizes.

Conditions of use (Environmental conditions):

- Structures subject to dry internal conditions.

Design:

- Anchorages are designed under the responsibility of an engineer experienced in anchorages and concrete work.
- Verifiable calculation notes and drawings are prepared taking account of the loads to be anchored. The position of the anchor is indicated on the design drawings (e. g. position of the anchor relative to reinforcement or to supports, etc.).
- Anchorages under static or quasi-static actions are designed for design method A in accordance with:
 - ETAG 001, Annex C, edition august 2010 or
 - CEN/TS 1992-4:2009
- The design of the anchoring under seismic action have to be carried out in accordance with:
 - EOTA Technical Report TR 045, edition February 2013
 - Anchoring's have to be placed outside of critical places like plastic hinges.
 - A distance mounting or mounting with mortar layer is not allowed.
- The design of the anchoring under fire exposure have to be carried in accordance with:
 - EOTA Technical Report 020, edition Mai 2014 or
 - CEN/TS 1992-4:2009, Annex D
 - In case of requirements for resistance of fire exposure it must be ensured that local spalling of the concrete cover does not occur.


Installation:

- Hole drilling by hammer-drilling only.
- Anchor installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site.
- In case of aborted hole: new drilling at a minimum distance away of twice the depth of the aborted hole or smaller distance if the aborted hole is filled with high strength mortar and if under shear or oblique tension load it is not the direction of the load application.
- The anchor may be used only once.
- After installation further turning of the anchor must not be possible.
- The head of the anchor must be supported on the fixture and is not damaged.

Liite B1

Table B1: Installation parameters MMS-plus

Size MMS-plus			6		7,5		10		12		
			h_{nom1}	h_{nom2}	h_{nom1}	h_{nom2}	h_{nom1}	h_{nom2}	h_{nom1}	h_{nom2}	
Embedment depth in concrete [mm]			35	45	35	55	50	65	75	90	
Nominal drill diameter	d_0	[mm]	5		6		8		10		
Drill bit cutting diameter	d_{cut} \leq	[mm]	5,40		6,40		8,45		10,45		
Depth of borehole	h_1 \geq	[mm]	40	50	40	65	60	75	85	100	
Diameter of clearance hole in the fixture	$d_f \leq$	[mm]	7		9		12		14		
Diameter Countersunk	d_h	[mm]	11,5		15,5		19,5		24		
Min. thickness of the concrete member	h_{min}	[mm]	100	100	100	100	100	115	125	150	
cracked and uncracked concrete	min. spacing s_{min}	[mm]	30	30	40	40	40	50	60	60	
	min. edge distance c_{min}	[mm]	30	30	40	40	40	50	60	60	
Recommended installation tool		[Nm]	Impact screw driver, max. power output T_{max} according manufacturer information								
			75	100	100	200	250				
Torque moment for threaded version (type MMS-plus V)	T_{inst}	[Nm]	-		15		20		30		

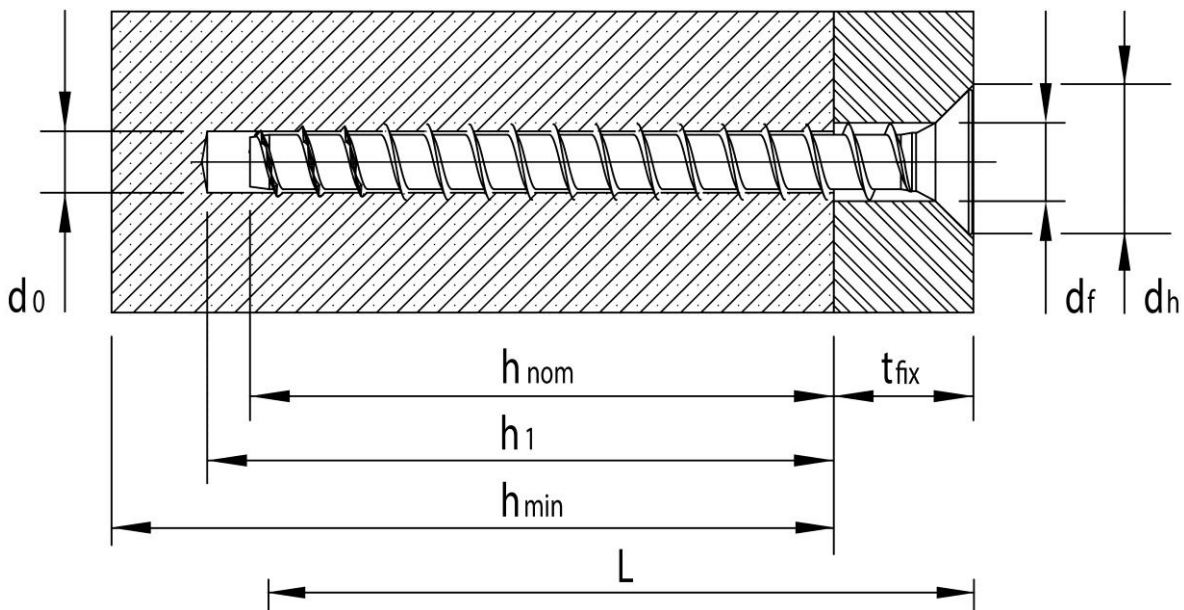

Liite B2

Table C1: Characteristic values for static and quasi-static tension MMS-plus

Size MMS-plus			6		7,5		10		12		
Embedment depth in concrete h_{nom} [mm]			h_{nom1}	h_{nom2}	h_{nom1}	h_{nom2}	h_{nom1}	h_{nom2}	h_{nom1}	h_{nom2}	
			35 ¹⁾	45	35 ¹⁾	55	50	65	75	90	
Steel failure for tension- and shear resistance											
Characteristic resistance	$N_{Rk,s}$	[kN]	10,8		17,6		32,1		49,9		
	$V_{Rk,s}$	[kN]	4,1		6,1		13,7		24,1		
	k_2 ²⁾	-	0,8								
	$M^0_{Rk,s}$	[Nm]	6,7		14,1		34,5		66,8		
Partial safety factor		γ_2	1,25								
Pullout											
Characteristic resistance in uncracked concrete C20/25		$N_{Rk,p}$	[kN]	4,0	6,0	4,0	9,0	12,0	16,0	20,0	25,0
Characteristic resistance in cracked concrete C20/25		$N_{Rk,p}$	[kN]	1,0	1,5	2,0	4,0	6,0	9,0	12,0	16,0
Increasing factor for concrete	C30/37	Ψ_c	-	1,22							
	C40/50			1,41							
	C50/60			1,55							
Concrete cone failure and splitting failure											
Effective anchorage depth		h_{ef}	[mm]	26	35	26	43	36	50	57	70
Factor for	cracked	k_{cr} ²⁾	-	7,2							
	uncracked	k_{unc} ²⁾	-	10,1							
Concrete cone	edge distance	$C_{cr,N}$	[mm]	1.5 h_{ef}							
	spacing	$S_{cr,N}$	[mm]	3 h_{ef}							
Splitting	edge distance	$C_{cr,sp}$	[mm]	1.8 h_{ef}							
	spacing	$S_{cr,sp}$	[mm]	3.6 h_{ef}							
Installation safety factor		γ_2 ³⁾ = γ_{inst} ²⁾	-	1,0							
Concrete pryout failure											
k-factor		$k^{(3)} = k_3^{(2)}$	-	1,0							2,0
Concrete edge failure											
Effective length of the anchor under shear loading		$l_{ef} = h_{ef}$	[mm]	26	35	26	43	36	50	57	70
Effective diameter of the anchor		d_{nom}	[mm]	5		6		8		10	

1) Only for non-structural applications
 2) Parameter only relevant for the design according to CEN/TS 1992-4:2009
 3) Parameter only relevant for the design according to ETAG 001, Annex C

Table C2: Characteristic values for seismic actions C1

Size MMS-plus			10	12	
Embedment depth in concrete [mm]	h_{nom}		h_{nom2}	h_{nom1}	h_{nom2}
			65	75	90
Steel failure for tension- and shear resistance					
Characteristic resistance	$N_{Rk,s,seis}$	[kN]	24,1	37,4	
	$V_{Rk,s,seis}$	[kN]	9,6	16,9	
Pullout					
Characteristic in cracked concrete	$N_{Rk,p,seis}$	[kN]	6,8	9,0	12,0
Concrete cone failure					
Effective anchorage depth	h_{ef}	[mm]	50	57	70
concrete edge distance	$c_{cr,N}$	[mm]	1,5 h_{ef}		
cone spacing	$s_{cr,N}$	[mm]	3 h_{ef}		
Installation safety factor	γ_2	-	1,0		
Concrete pryout failure					
k-factor	k	-	2,0	1,0	
Concrete edge failure					
Effective length of the anchor under shear loading	$l_{ef} = h_{ef}$	[mm]	50	57	70
Effective diameter of the anchor	d_{nom}	[mm]	8	10	

Liite C2

Table C3: Characteristic values under fire exposure

Size MMS-plus				6		7,5		10		12	
				h_{nom1}	h_{nom2}	h_{nom1}	h_{nom2}	h_{nom1}	h_{nom2}	h_{nom1}	h_{nom2}
Embedment depth in concrete h_{nom} [mm]				35	45	35	55	50	65	75	90
Steel failure for tension- and shear resistance ($F_{Rk,fi} = N_{Rk,fi} = V_{Rk,fi}$)											
Characteristic resistance	R30	$F_{Rk,fi}$	[kN]	0,25	0,4	0,5	1,0	1,5	2,3	3,0	3,0
	R60	$F_{Rk,fi}$	[kN]	0,25	0,4	0,5	0,8	1,4	1,4	2,1	2,1
	R90	$F_{Rk,fi}$	[kN]	0,25	0,4	0,5	0,5	1,0	1,0	1,5	1,5
	R120	$F_{Rk,fi}$	[kN]	0,2	0,3	0,4	0,4	0,8	0,8	1,2	1,2
	R30	$M^0_{Rk,s,fi}$	[Nm]	0,5		1,1		2,7		5,3	
	R60	$M^0_{Rk,s,fi}$	[Nm]	0,3		0,6		1,5		2,8	
	R90	$M^0_{Rk,s,fi}$	[Nm]	0,2		0,4		1,1		2,0	
	R120	$M^0_{Rk,s,fi}$	[Nm]	0,2		0,3		0,9		1,6	
Edge distance											
R30 to R120		$C_{cr,fi}$	[mm]	2 h_{ef}							
Spacing											
R30 to R120		$S_{cr,fi}$	[mm]	2 $C_{cr,fi}$							

Table C4: Displacements under tension loads

Size MMS-plus				6		7,5		10		12	
Embedment depth in concrete		h_{nom}	[mm]	h_{nom1}	h_{nom2}	h_{nom1}	h_{nom2}	h_{nom1}	h_{nom2}	h_{nom1}	h_{nom2}
				35	45	35	55	50	65	75	90
Cracked concrete C20/25 to C50/60	tension	N	[kN]	1,9	3,0	1,9	5,3	5,7	7,9	10,7	12,8
	displacement	$\bar{\delta}_{N0}$	[mm]	0,11	0,11	0,06	0,12	0,06	0,07	0,05	0,19
		$\bar{\delta}_{N\infty}$	[mm]	0,30	0,28	0,38	1,03	0,75	0,72	0,74	0,60
Uncracked concrete C20/25 to C50/60	tension	N	[kN]	0,5	0,7	0,9	2,0	2,9	4,3	5,7	6,4
	displacement	$\bar{\delta}_{N0}$	[mm]	0,01	0,02	0,03	0,04	0,03	0,09	0,05	0,02
		$\bar{\delta}_{N\infty}$	[mm]	0,14	0,09	0,12	0,11	0,08	0,09	0,07	0,22

Table C5: Displacements under shear loads

Size MMS-plus				6		7,5		10		12	
Embedment depth in concrete		h_{nom}	[mm]	h_{nom1}	h_{nom2}	h_{nom1}	h_{nom2}	h_{nom1}	h_{nom2}	h_{nom1}	h_{nom2}
				35	45	35	55	50	65	75	90
Cracked and uncracked concrete C20/25 to C50/60	shear load	V	[kN]	2	2	4	4	8	8	12	12
	displacement	$\bar{\delta}_{N0}$	[mm]	0,14	0,13	0,09	0,11	0,18	0,13	0,18	0,18
		$\bar{\delta}_{N\infty}$	[mm]	0,20	0,19	0,13	0,16	0,27	0,20	0,27	0,27