

# VYHLÁSENIE O PARAMETROCH

## HECO-DoP\_ETA\_15/0784\_MMS-plus\_1606\_SK

1. Jedinečný identifikačný kód typu výrobku:  
**MULTI-MONTI-plus (MMS-plus)**

2. Typ, číslo výrobnej dávky alebo sériové číslo, alebo akýkoľvek iný prvok umožňujúci identifikáciu stavebného výrobku, ako sa vyžaduje podľa článku 11 ods. 4:

**Označenie podľa smernice ETA-15/0784 dodatok A2, A3**

**Číslo šarže: pozri obal výrobku**

3. Zamýšľané použitia stavebného výrobku, ktoré uvádza výrobca, v súlade s uplatniteľnou harmonizovanou technickou špecifikáciou:

**ETA-15/0784 dodatok B1**

<b>Typ hmoždinky</b>	Skrutková kotva
<b>Určené použitie</b>	<u>Betón C20/25 až C50/60 (EN 206)</u> - netrhaný: Ø6; Ø7,5; Ø10 a Ø12 - trhaný: Ø6; Ø7,5; Ø10 a Ø12
<b>Možnosť/trieda</b>	<u>Možnosť 1</u> Seizmická: Trieda výkonnosti C1
<b>Zaťaženie</b>	Statické, kvázi-statické, seizmické (Ø10 + Ø12), vystavenie ohňu
<b>Materiál/vyhotovenie</b>	<u>Pozinkovaná oceľ:</u> - použitie v podmienkach suchého interiéru - rôzne tvary hláv

4. Meno, registrované obchodné meno alebo registrovaná ochranná známka a kontaktná adresa výrobcu, ako sa vyžaduje podľa článku 11 ods. 5:

**HECO-Schrauben GmbH & Co. KG**

**Dr.-Kurt-Steim-Str. 28**

**78713 Schramberg (Germany)**

5. V prípade potreby meno a kontaktná adresa splnomocneného zástupcu, ktorého splnomocnenie zahŕňa úlohy vymedzené v článku 12 ods. 2:

-

6. Systém alebo systémy posudzovania a overovania nemennosti parametrov stavebného výrobku, ako sa uvádzajú v prílohe V:

**System 1**

7. V prípade vyhlásenia o parametroch týkajúceho sa stavebného výrobku, na ktorý sa vzťahuje harmonizovaná norma:

-

8. V prípade vyhlásenia o parametroch týkajúceho sa stavebného výrobku, na ktorý bolo vypracované európske technické posúdenie:

- Posúdil: Nemecký inštitút pre stavebnú techniku DIBt
- Notifikovaný orgán: Otto Graf inštitút v Stuttgarte, identifikačné číslo 0672
- Použitá smernica: ETAG 001 Časť 1, 3 (04.2013)
- Osvedčenia o súlade: 0672-CPR-0635

9. Deklarované parametre:

Hlavné vlastnosti	Metóda merania	Výkon	Harmonizovaná technická špecifikácia
<b>Charakteristický odpor pri zaťažení v ťahu</b>	ETAG 001, dodatok: C, metóda A CEN/TS 1992-4:2009, metóda A	ETA-15/0784: dodatok C1	ETAG 001 Part 1, 3  ETAG 001, dodatok E  EOTA TR 020 (odpor pri vystavení ohňu)
	EOTA TR 045	ETA-15/0784: dodatok C2	
	EOTA TR 020 (odpor pri vystavení ohňu) CEN/TS 1992-4: dodatok D	ETA-15/0784: dodatok C3	
<b>Charakteristický odpor pri priečnom zaťažení</b>	ETAG 001, dodatok: C, metóda A CEN/TS 1992-4:2009, metóda A	ETA-15/0784: dodatok C1	
	EOTA TR 045	ETA-15/0784: dodatok C2	
	EOTA TR 020 (odpor pri vystavení ohňu) CEN/TS 1992-4: dodatok D	ETA-15/0784: dodatok C3	
<b>Montážne parametre</b>		ETA-15/0784: dodatok B2	
<b>Modul posuvu kser</b>	ETAG 001, dodatok: C, metóda A CEN/TS 1992-4:2009, metóda A	ETA-15/0784: dodatok C4	

10. Parametre výrobku uvedené v bodoch 1 a 2 sú v zhode s deklarovými parametrami v bode 9. Toto vyhlásenie o parametroch sa vydáva na výhradnú zodpovednosť výrobcu uvedeného v bode 4.

Podpísal(-a) za a v mene výrobcu:



Schramberg, 01.07.2016

v zast.

Andreas Hettich, Vedúci PM/Marketing

## Specifications of intended use

### Use of the anchoring:

- Static and quasi static loads: all sizes.
- Seismic category C1:  
MMS-plus all Versions, size 10 with maximum embedment depth ( $h_{nom2}$ ) and size 12 with the embedment depth  $h_{nom1}$  and  $h_{nom2}$ .
- Fire exposure: all sizes.

### Base Materials:

- Reinforced or non-reinforced normal weight concrete according to EN 206-1:2000.
- Strength classes C20/25 to C50/60 according to EN 206-1:2000.
- Non-cracked and cracked concrete: all sizes.

### Conditions of use (Environmental conditions):

- Structures subject to dry internal conditions.

### Design:

- Anchorages are designed under the responsibility of an engineer experienced in anchorages and concrete work.
- Verifiable calculation notes and drawings are prepared taking account of the loads to be anchored. The position of the anchor is indicated on the design drawings (e. g. position of the anchor relative to reinforcement or to supports, etc.).
- Anchorages under static or quasi-static actions are designed for design method A in accordance with:
  - ETAG 001, Annex C, edition august 2010 or
  - CEN/TS 1992-4:2009
- The design of the anchoring under seismic action have to be carried out in accordance with:
  - EOTA Technical Report TR 045, edition February 2013
  - Anchoring's have to be placed outside of critical places like plastic hinges.
  - A distance mounting or mounting with mortar layer is not allowed.
- The design of the anchoring under fire exposure have to be carried in accordance with:
  - EOTA Technical Report 020, edition Mai 2014 or
  - CEN/TS 1992-4:2009, Annex D
  - In case of requirements for resistance of fire exposure it must be ensured that local spalling of the concrete cover does not occur.


### Installation:

- Hole drilling by hammer-drilling only.
- Anchor installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site.
- In case of aborted hole: new drilling at a minimum distance away of twice the depth of the aborted hole or smaller distance if the aborted hole is filled with high strength mortar and if under shear or oblique tension load it is not the direction of the load application.
- The anchor may be used only once.
- After installation further turning of the anchor must not be possible.
- The head of the anchor must be supported on the fixture and is not damaged.

**Dodatok B1**

**Table B1: Installation parameters MMS-plus**

Size MMS-plus			6		7,5		10		12	
			$h_{nom1}$	$h_{nom2}$	$h_{nom1}$	$h_{nom2}$	$h_{nom1}$	$h_{nom2}$	$h_{nom1}$	$h_{nom2}$
Embedment depth in concrete [mm]			35	45	35	55	50	65	75	90
Nominal drill diameter	$d_0$	[mm]	5		6		8		10	
Drill bit cutting diameter	$d_{cut}$ $\leq$	[mm]	5,40		6,40		8,45		10,45	
Depth of borehole	$h_1$ $\geq$	[mm]	40	50	40	65	60	75	85	100
Diameter of clearance hole in the fixture	$d_f \leq$	[mm]	7		9		12		14	
Diameter Countersunk	$d_h$	[mm]	11,5		15,5		19,5		24	
Min. thickness of the concrete member	$h_{min}$	[mm]	100	100	100	100	100	115	125	150
cracked and uncracked concrete	min. spacing $s_{min}$	[mm]	30	30	40	40	40	50	60	60
	min. edge distance $c_{min}$	[mm]	30	30	40	40	40	50	60	60
Recommended installation tool		[Nm]	Impact screw driver, max. power output $T_{max}$ according manufacturer information							
			75	100	100	200	250			
Torque moment for threaded version (type MMS-plus V)	$T_{inst}$	[Nm]	-		15		20		30	

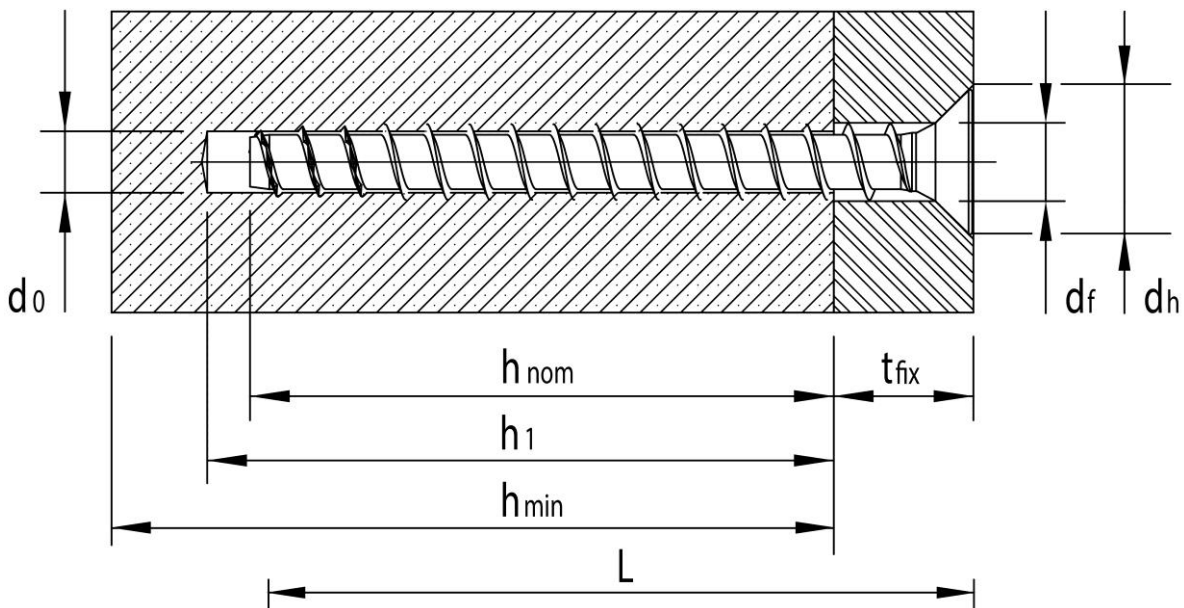

**Dodatok B2**

**Table C1: Characteristic values for static and quasi-static tension MMS-plus**

Size MMS-plus			6		7,5		10		12				
			$h_{nom1}$	$h_{nom2}$	$h_{nom1}$	$h_{nom2}$	$h_{nom1}$	$h_{nom2}$	$h_{nom1}$	$h_{nom2}$			
Embedment depth in concrete $h_{nom}$ [mm]			35 <sup>1)</sup>	45	35 <sup>1)</sup>	55	50	65	75	90			
<b>Steel failure for tension- and shear resistance</b>													
Characteristic resistance	$N_{Rk,s}$ [kN]		10,8		17,6		32,1		49,9				
	$V_{Rk,s}$ [kN]		4,1		6,1		13,7		24,1				
	$k_2$ <sup>2)</sup>	-	0,8										
	$M^0_{Rk,s}$ [Nm]		6,7		14,1		34,5		66,8				
Partial safety factor		$\gamma_2$	-								1,25		
<b>Pullout</b>													
Characteristic resistance in uncracked concrete C20/25		$N_{Rk,p}$ [kN]	4,0	6,0	4,0	9,0	12,0	16,0	20,0	25,0			
Characteristic resistance in cracked concrete C20/25		$N_{Rk,p}$ [kN]	1,0	1,5	2,0	4,0	6,0	9,0	12,0	16,0			
Increasing factor for concrete	C30/37	$\Psi_c$	-								1,22		
	C40/50		-								1,41		
	C50/60		-								1,55		
<b>Concrete cone failure and splitting failure</b>													
Effective anchorage depth		$h_{ef}$ [mm]	26	35	26	43	36	50	57	70			
Factor for	cracked	$k_{cr}$ <sup>2)</sup>	-								7,2		
	uncracked	$k_{unc}$ <sup>2)</sup>	-								10,1		
Concrete cone	edge distance	$C_{cr,N}$ [mm]	-								1.5 $h_{ef}$		
	spacing	$S_{cr,N}$ [mm]	-								3 $h_{ef}$		
Splitting	edge distance	$C_{cr,sp}$ [mm]	-								1.8 $h_{ef}$		
	spacing	$S_{cr,sp}$ [mm]	-								3.6 $h_{ef}$		
Installation safety factor		$\gamma_2$ <sup>3)</sup> = $\gamma_{inst}$ <sup>2)</sup>	-								1,0		
<b>Concrete pryout failure</b>													
k-factor		$k^{(3)} = k_3^{(2)}$	-								1,0		2,0
<b>Concrete edge failure</b>													
Effective length of the anchor under shear loading		$l_{ef} = h_{ef}$ [mm]	26	35	26	43	36	50	57	70			
Effective diameter of the anchor		$d_{nom}$ [mm]	5		6		8		10				

<sup>1)</sup> Only for non-structural applications

<sup>2)</sup> Parameter only relevant for the design according to CEN/TS 1992-4:2009

<sup>3)</sup> Parameter only relevant for the design according to ETAG 001, Annex C

**Table C2: Characteristic values for seismic actions C1**

Size MMS-plus			10	12	
Embedment depth in concrete [mm]	$h_{nom}$		$h_{nom2}$	$h_{nom1}$	$h_{nom2}$
			65	75	90
<b>Steel failure for tension- and shear resistance</b>					
Characteristic resistance	$N_{Rk,s,seis}$	[kN]	24,1	37,4	
	$V_{Rk,s,seis}$	[kN]	9,6	16,9	
<b>Pullout</b>					
Characteristic in cracked concrete	$N_{Rk,p,seis}$	[kN]	6,8	9,0	12,0
<b>Concrete cone failure</b>					
Effective anchorage depth	$h_{ef}$	[mm]	50	57	70
concrete edge distance	$c_{cr,N}$	[mm]	1,5 $h_{ef}$		
cone spacing	$s_{cr,N}$	[mm]	3 $h_{ef}$		
Installation safety factor	$\gamma_2$	-	1,0		
<b>Concrete pryout failure</b>					
k-factor	k	-	2,0	1,0	
<b>Concrete edge failure</b>					
Effective length of the anchor under shear loading	$l_{ef} = h_{ef}$	[mm]	50	57	70
Effective diameter of the anchor	$d_{nom}$	[mm]	8	10	

**Dodatok C2**

**Table C3: Characteristic values under fire exposure**

Size MMS-plus				6		7,5		10		12	
Embedment depth in concrete $h_{nom}$ [mm]				$h_{nom1}$	$h_{nom2}$	$h_{nom1}$	$h_{nom2}$	$h_{nom1}$	$h_{nom2}$	$h_{nom1}$	$h_{nom2}$
				35	45	35	55	50	65	75	90
<b>Steel failure for tension- and shear resistance (<math>F_{Rk,fi} = N_{Rk,fi} = V_{Rk,fi}</math>)</b>											
Characteristic resistance	R30	$F_{Rk,fi}$	[kN]	0,25	0,4	0,5	1,0	1,5	2,3	3,0	3,0
	R60	$F_{Rk,fi}$	[kN]	0,25	0,4	0,5	0,8	1,4	1,4	2,1	2,1
	R90	$F_{Rk,fi}$	[kN]	0,25	0,4	0,5	0,5	1,0	1,0	1,5	1,5
	R120	$F_{Rk,fi}$	[kN]	0,2	0,3	0,4	0,4	0,8	0,8	1,2	1,2
	R30	$M^0_{Rk,s,fi}$	[Nm]	0,5		1,1		2,7		5,3	
	R60	$M^0_{Rk,s,fi}$	[Nm]	0,3		0,6		1,5		2,8	
	R90	$M^0_{Rk,s,fi}$	[Nm]	0,2		0,4		1,1		2,0	
	R120	$M^0_{Rk,s,fi}$	[Nm]	0,2		0,3		0,9		1,6	
Edge distance											
R30 to R120		$C_{cr,fi}$	[mm]	2 $h_{ef}$							
Spacing											
R30 to R120		$S_{cr,fi}$	[mm]	2 $C_{cr,fi}$							

**Table C4: Displacements under tension loads**

Size MMS-plus				6		7,5		10		12	
Embedment depth in concrete		$h_{nom}$	[mm]	$h_{nom1}$	$h_{nom2}$	$h_{nom1}$	$h_{nom2}$	$h_{nom1}$	$h_{nom2}$	$h_{nom1}$	$h_{nom2}$
				35	45	35	55	50	65	75	90
Cracked concrete C20/25 to C50/60	tension	N	[kN]	1,9	3,0	1,9	5,3	5,7	7,9	10,7	12,8
	displacement	$\bar{\delta}_{N0}$	[mm]	0,11	0,11	0,06	0,12	0,06	0,07	0,05	0,19
		$\bar{\delta}_{N\infty}$	[mm]	0,30	0,28	0,38	1,03	0,75	0,72	0,74	0,60
Uncracked concrete C20/25 to C50/60	tension	N	[kN]	0,5	0,7	0,9	2,0	2,9	4,3	5,7	6,4
	displacement	$\bar{\delta}_{N0}$	[mm]	0,01	0,02	0,03	0,04	0,03	0,09	0,05	0,02
		$\bar{\delta}_{N\infty}$	[mm]	0,14	0,09	0,12	0,11	0,08	0,09	0,07	0,22

**Table C5: Displacements under shear loads**

Size MMS-plus				6		7,5		10		12	
Embedment depth in concrete		$h_{nom}$	[mm]	$h_{nom1}$	$h_{nom2}$	$h_{nom1}$	$h_{nom2}$	$h_{nom1}$	$h_{nom2}$	$h_{nom1}$	$h_{nom2}$
				35	45	35	55	50	65	75	90
Cracked and uncracked concrete C20/25 to C50/60	shear load	V	[kN]	2	2	4	4	8	8	12	12
	displacement	$\bar{\delta}_{N0}$	[mm]	0,14	0,13	0,09	0,11	0,18	0,13	0,18	0,18
		$\bar{\delta}_{N\infty}$	[mm]	0,20	0,19	0,13	0,16	0,27	0,20	0,27	0,27